


GENERAL NOTES:

- A VALVE BOX RING AND COVER PER C.O.A. STD. DWG. 2328.
- B 10" DIAMETER RIBBED OR CORRUGATED PVC OR PE PIPE WITH SMOOTH INTERIOR (C-900).
- C NEW OR EXISTING VALVE.
- D COMPACTED BACKFILL. SOIL OR BASE COURSE MATERIAL (95% COMPACTION). SEE SECTION 701.
- E CONCRETE COLLAR PER C.O.A. STD. DWG. 2461.
- F TOP OF CONCRETE COLLAR SHALL BE STAMPED WITH LINE SIZE AND DIRECTION. MINIMUM LETTER SIZE SHALL BE 3" IN HEIGHT.
- G MIN. 6" OR MATCH EXISTING.

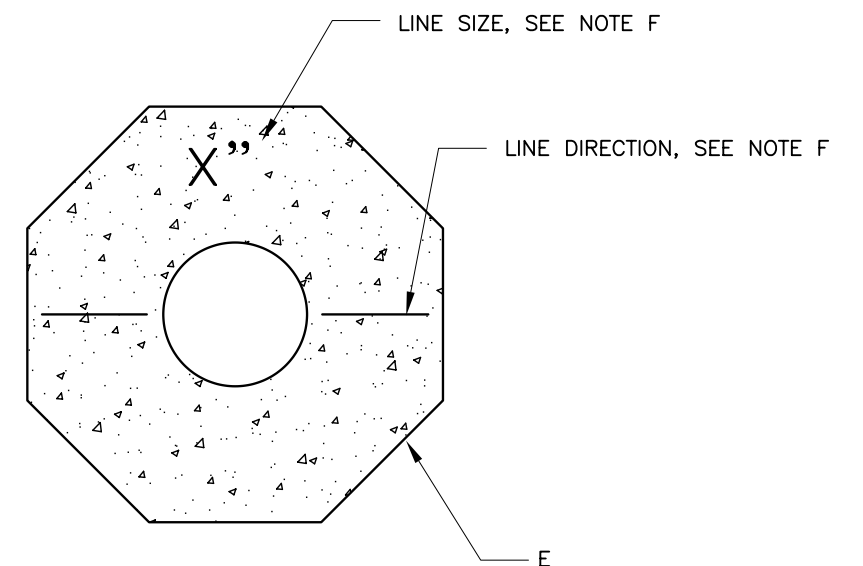

LABEL REQUIREMENTS

REVISIONS	CITY OF ALBUQUERQUE
	WATER VALVE BOX
	DWG. 2326 JANUARY 2003